


One Line Diagram

2% H2 Relay Signal
Rated: 0.5 A @ 28 VDC

L G N 120/240 VAC input power

1% H2 Relay Signal
Rated: 15 A @ 120 VAC
10 A @ 240 VAC
10 A @ 30 VDC Max

+12 to +48 VDC Input
DC Input to Alarm Module

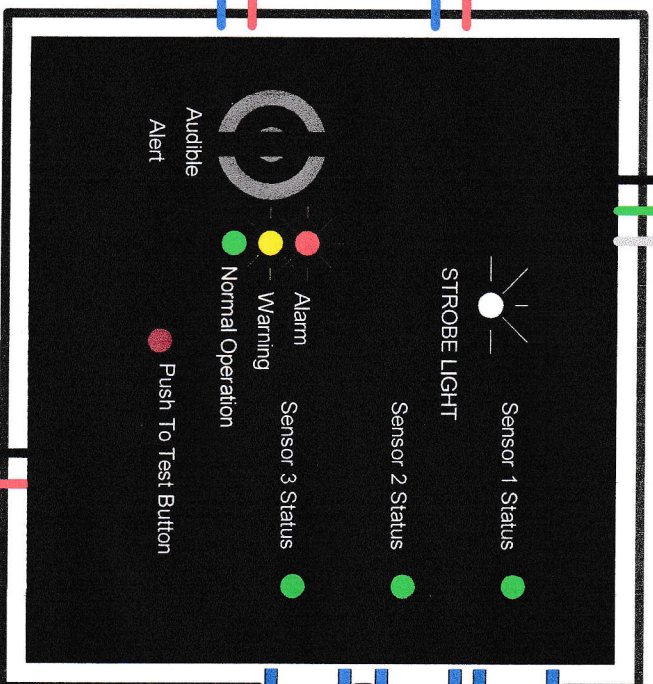

Cat5 sensor input cable 25'

(50' or 100') optional Cable Lengths

LEAK CONTROL
BENELUX
HYDROGEN, WE CAN SENSE IT

WWW.LEAKCONTROL.NL
+31-(0)786143732
info@leakcontrol.nl